

5726 Sonoma Drive Pleasanton, CA 94566 Phone: 925.600.0475


Fax: 925.600.0618

TECHNICAL BULLETIN

Lath & Plaster Control Joints over Continuous Lath

The ASTM C1063¹ compliant method for installing control joints is to do so prior to the lath installation, thereby providing discontinuous lath terminating into the joint. ASTM C1063 does not, however, explain that to do so, you must have backing (properly oriented framing members) at either side of the vertical joint to properly secure the discontinuous ends of the lath and the flanges of the accessory. On horizontal applications (soffits/ceilings), additional backing is not required where the joint spans perpendicular framing members spaced not greater than 16 inches on center.

Framing members/backing shall be specified by the architect or designer and installed where indicated on the plans. Where backing is not provided for and cannot be added for financial, scheduling or other issues, vertical control joints are surface-applied to the face of continuous lath with tie wire. The guide specification EMLA 920² details a surface applied joint and calls it an "Architectural Joint".

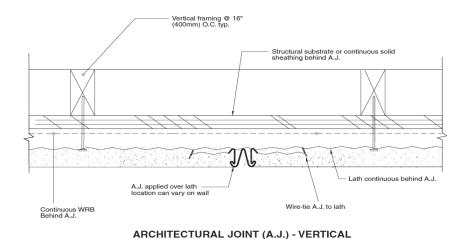

¹ Standard Specification for Lathing and Furring to Receive Interior and Exterior Portland Cement-Based Plaster

² Guide Specification for Metal Lathing and Furring – Fifth Edition 2009



5726 Sonoma Drive Pleasanton, CA 94566 Phone: 925.600.0475

Fax: 925.600.0618

Control Joints will provide stress relief from minor movement, such as that associated with hydration during the first 21 days following the initial plaster application. Control Joints are not intended to be a substitution for an expansion joint, where accommodation of structural movement is required.

- ¹ Standard Specification for Lathing and Furring to Receive Interior and Exterior Portland Cement-Based Plaster
- ¹ Guide Specification for Metal Lathing and Furring Fifth Edition 2009